



2 WELL HOT & COLD 120/208-240V WIRING DIAGRAM



IMPORTANT – PLEASE OBSERVE VIEWER ORIENTATION NOTE IN EACH BOX

ITEM NUMBERS  
FC-6HC-02208  
FC-6HC-02208-AD

**WARNING – REQUIRED NEMA 14-20R RECEPTACLE MUST BE WIRED ACCORDINGLY OR CONDENSING UNIT / AUXILIARY COMPONENT DAMAGE WILL RESULT – WARRANTY WILL BE VOID. TEST RECEPTACLE PER THE FOLLOWING:**

G, GROUND  
X, LINE 1  
Y, LINE 2  
W, NEUTRAL  
  
X-Y, 208-240V  
X-W, 120V  
Y-W, 120V

BLK & RED POWER CORD WIRES ARE INTERCHANGEABLE ON PLUG TERMINALS X & Y

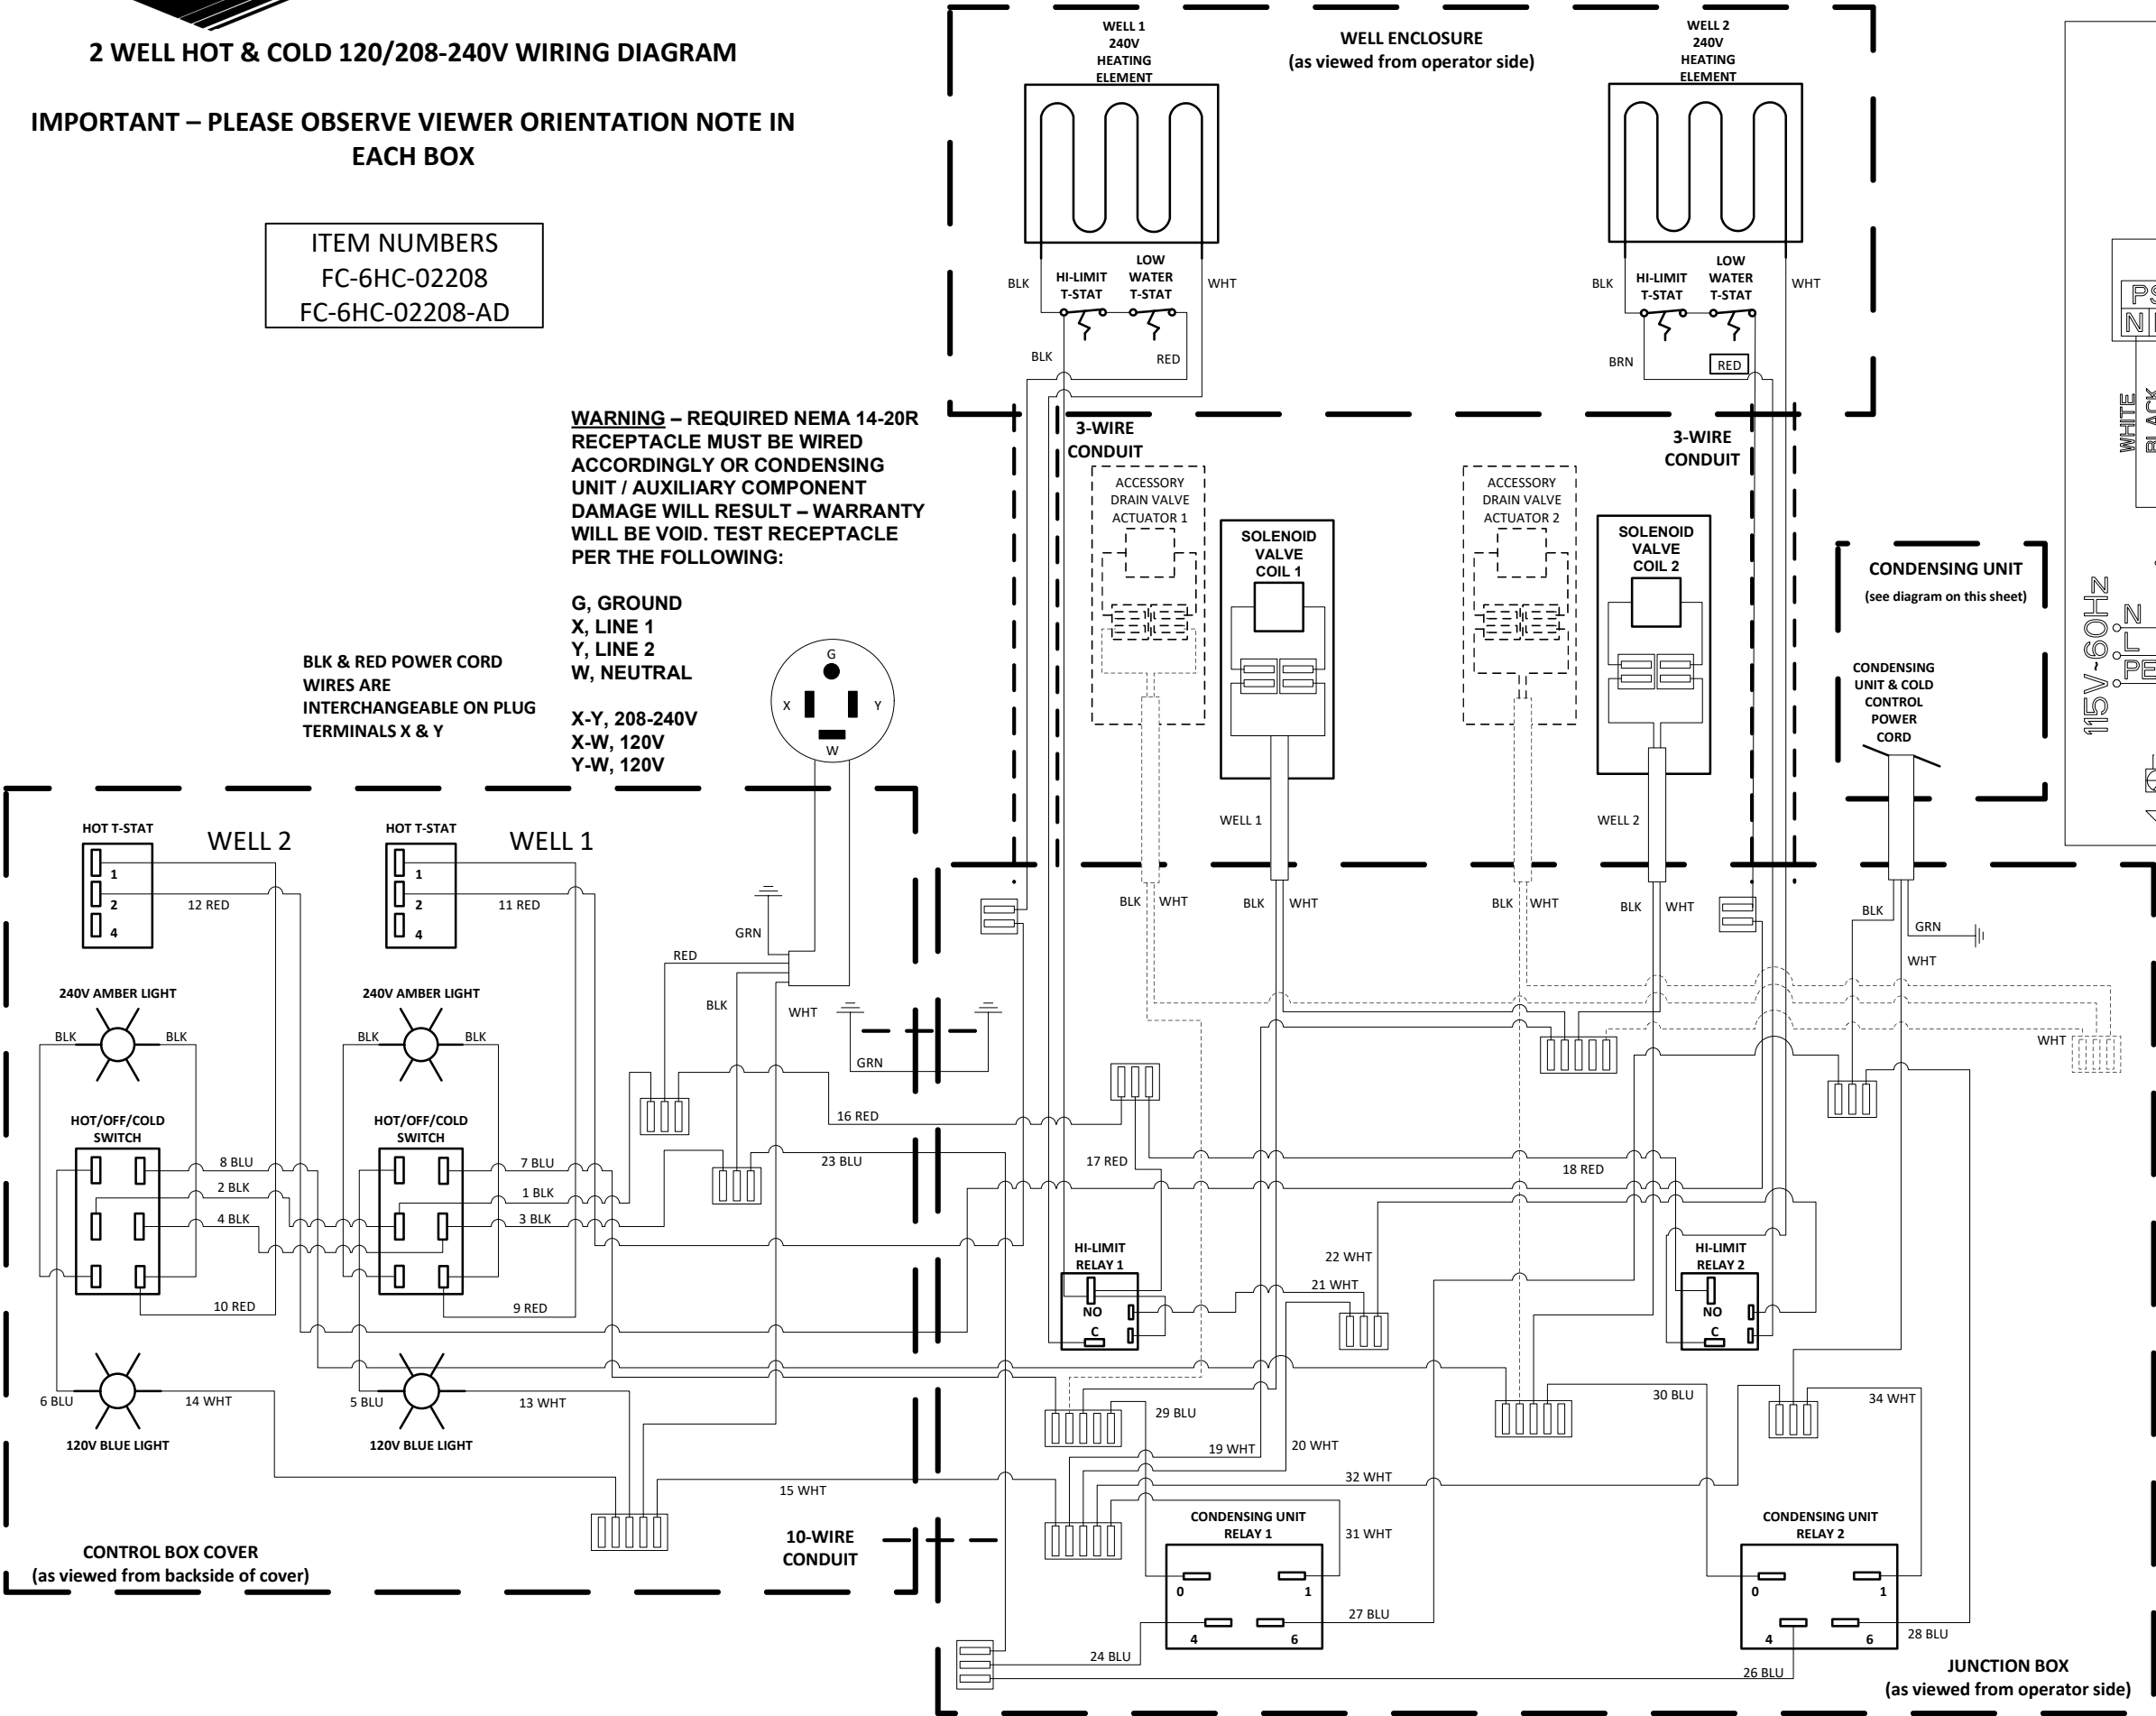

- PS - POWER SUPPLY
- HPS - HIGH PRESSURE SWITCH
- PT - PRESSURE TRANSDUCER
- COMP - COMPRESSOR
- OLP - OVERLOAD PROTECTION
- MF - MOTOR FAN
- CS - STARTING CAPACITOR

