




WARNING – REQUIRED NEMA 14-20R RECEPTACLE MUST BE WIRED ACCORDINGLY OR CONDENSING UNIT / AUXILIARY COMPONENT DAMAGE WILL RESULT – WARRANTY WILL BE VOID. TEST RECEPTACLE PER THE FOLLOWING:

G, GROUND
X, LINE 1
Y, LINE 2
W, NEUTRAL


X-Y, 208-240V
X-W, 120V
Y-W, 120V



BLK & RED POWER CORD WIRES ARE INTERCHANGEABLE ON PLUG TERMINALS X & Y

1 WELL HOT & COLD
WIRING DIAGRAM
120/208-240V

ITEM NUMBER
FC-6HC-01208-AD

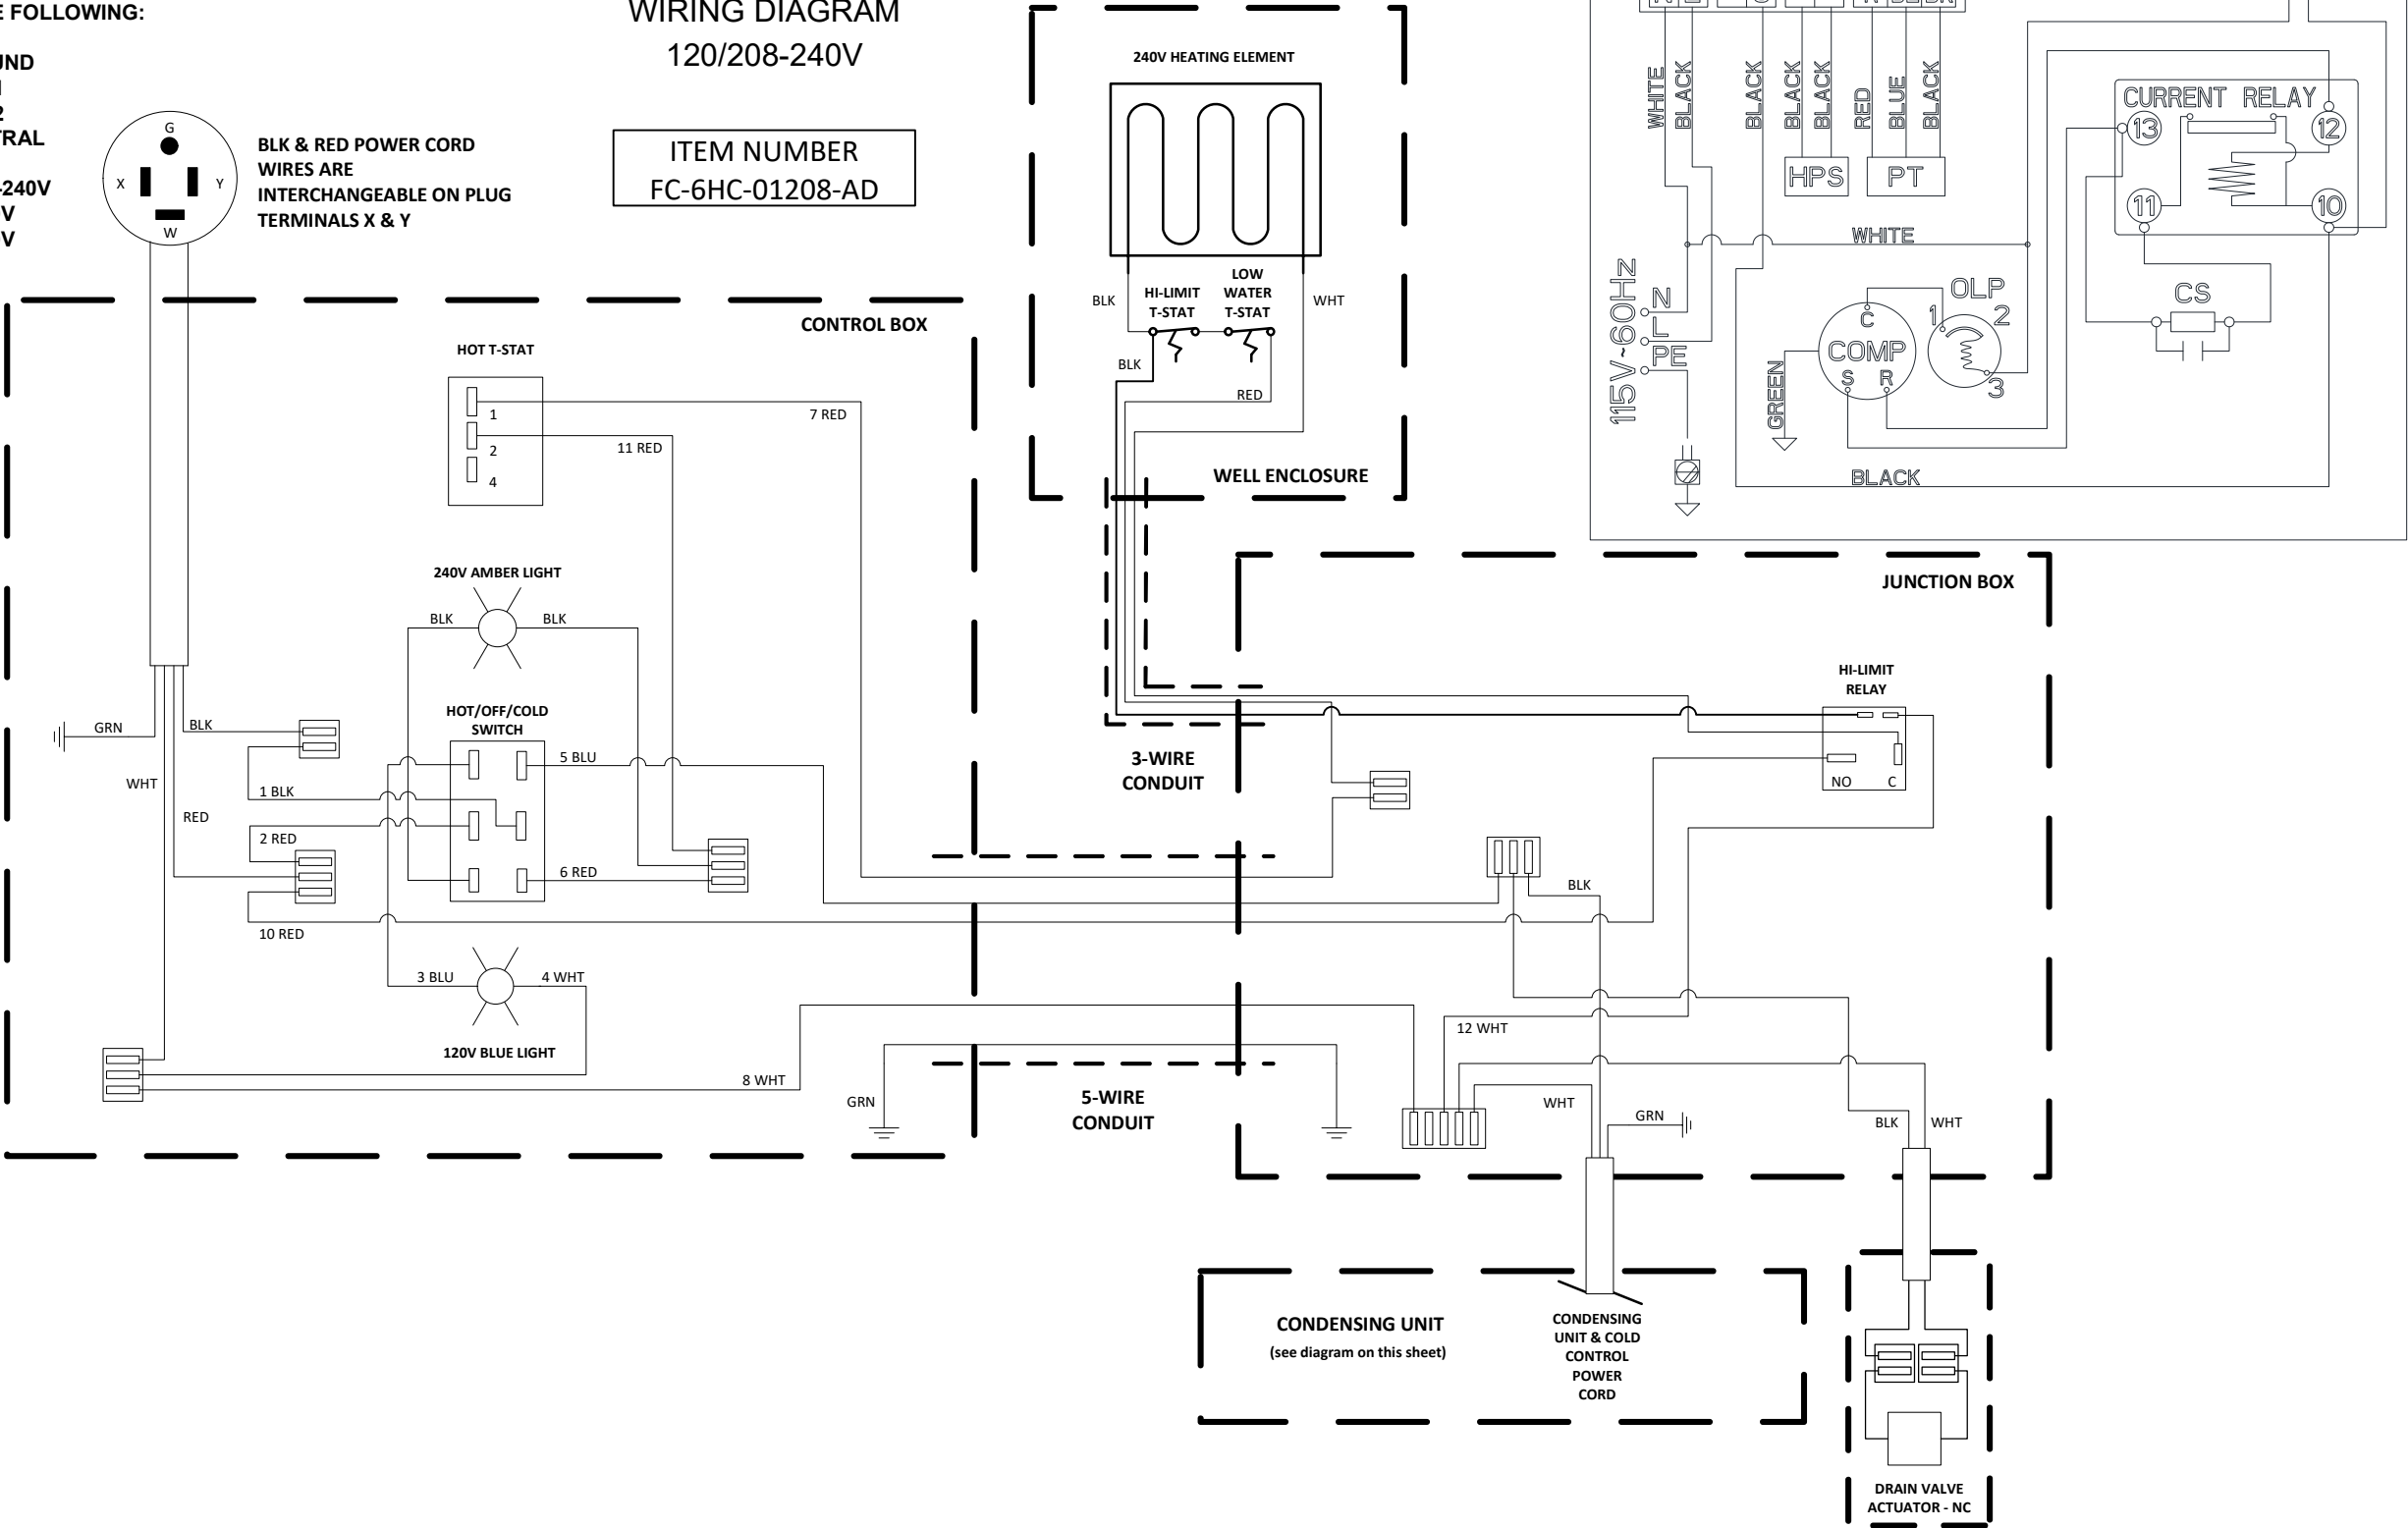

- PS - POWER SUPPLY
- HPS - HIGH PRESSURE SWITCH
- PT - PRESSURE TRANSDUCER
- COMP - COMPRESSOR
- OLP - OVERLOAD PROTECTION
- MF - MOTOR FAN
- CS - STARTING CAPACITOR

